


120 VOLT - 1Ø - 60 Hz - 20 AMP SERVICE

NOTE: RECIRCULATION PUMP, AIR PUMP AND CONTROL PANEL MUST BE PROPERLY GROUNDED.

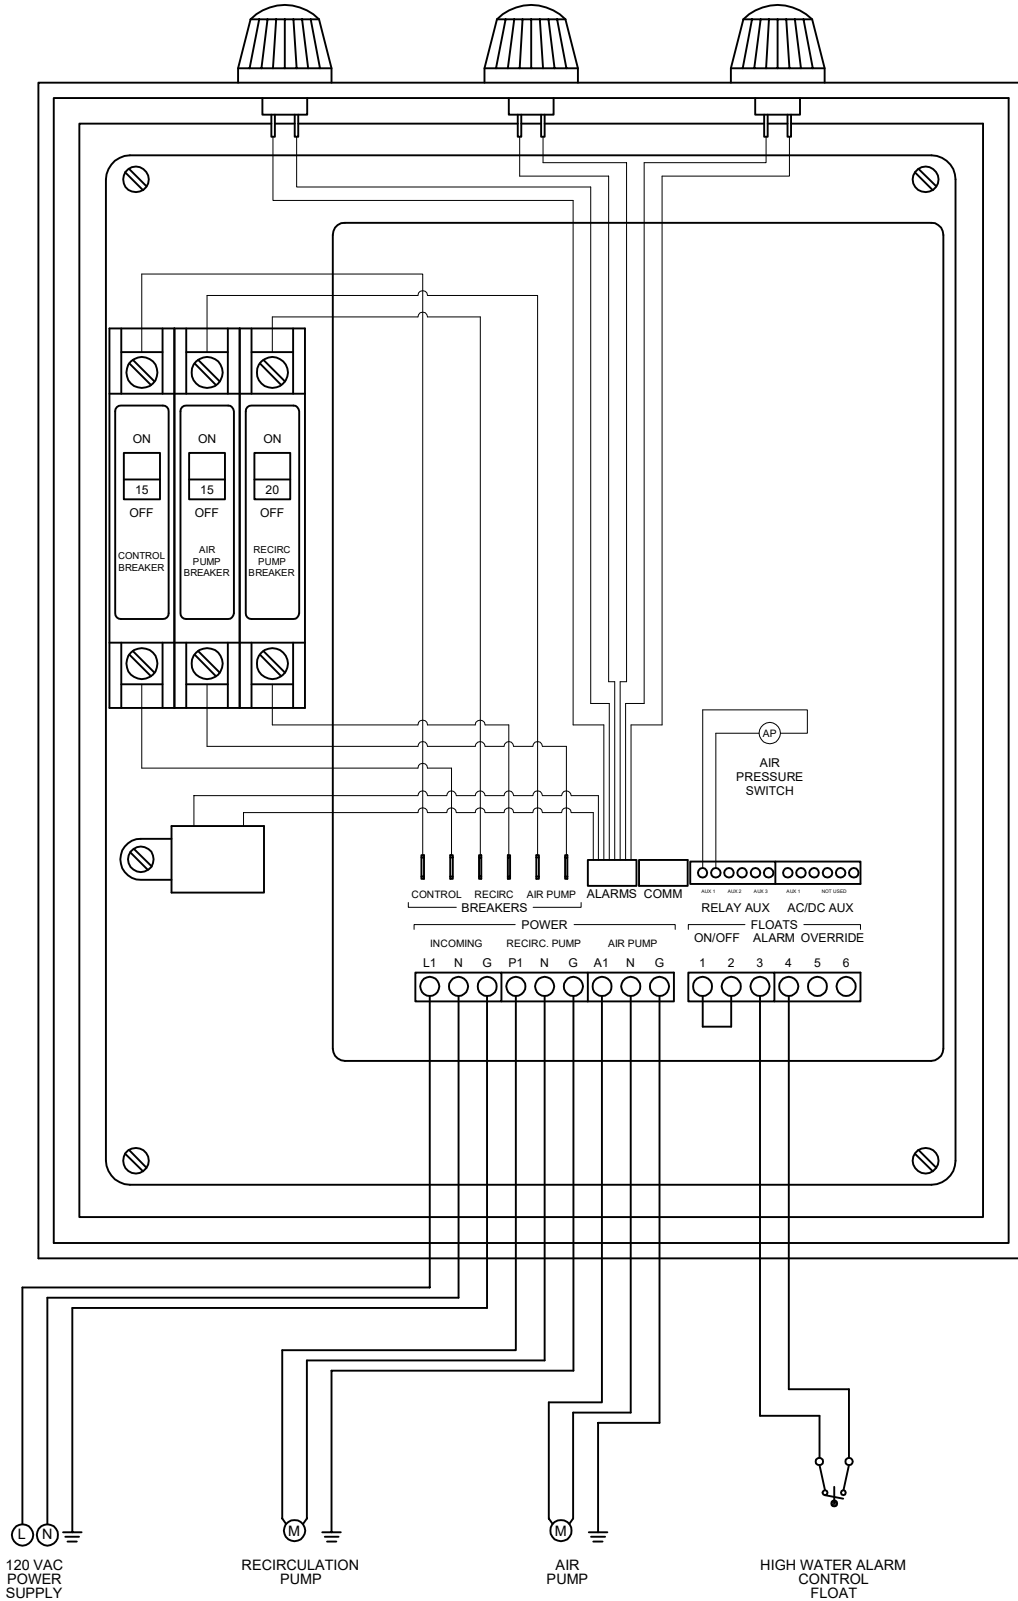

GENERAL NOTES:

- ① A DEDICATED 20 AMP CIRCUIT BREAKER AT MAIN SERVICE PANEL SHOULD NOT BE ENERGIZED UNTIL THE AIR PUMP IS INSTALLED AND READY TO BE PLACED INTO OPERATION.
- ② INSURE THE AIR PUMP IS OPERATING WHEN THE FACILITY IS OCCUPIED.
- ③ THE LOCAL, LICENSED NORWECO DISTRIBUTOR WILL PLACE THE AIR PUMP INTO SERVICE.

PART NUMBER:							
U.S. AND FOREIGN PATENTS PENDING © MMXXI	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: center;"><i>norweco</i></td> <td style="font-size: 8px;"> REVISION DATE: 03-01-2023 REVISION: A </td> </tr> <tr> <td style="font-size: 8px;"> SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 500 - 800 GPD SYSTEMS </td> <td style="font-size: 8px;"> APPROVED BY: JMM DATE: 11-29-2021 SCALE: NTS </td> </tr> <tr> <td style="font-size: 8px;"> THIS DOCUMENT IS THE PROPERTY OF NORWECO INDUSTRIES CORPORATION AND MAY NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF NORWECO INDUSTRIES. </td> <td style="font-size: 8px;"> DRAWING NO: PC-5-7726 </td> </tr> </table>	<i>norweco</i>	REVISION DATE: 03-01-2023 REVISION: A	SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 500 - 800 GPD SYSTEMS	APPROVED BY: JMM DATE: 11-29-2021 SCALE: NTS	THIS DOCUMENT IS THE PROPERTY OF NORWECO INDUSTRIES CORPORATION AND MAY NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF NORWECO INDUSTRIES.	DRAWING NO: PC-5-7726
<i>norweco</i>	REVISION DATE: 03-01-2023 REVISION: A						
SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 500 - 800 GPD SYSTEMS	APPROVED BY: JMM DATE: 11-29-2021 SCALE: NTS						
THIS DOCUMENT IS THE PROPERTY OF NORWECO INDUSTRIES CORPORATION AND MAY NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF NORWECO INDUSTRIES.	DRAWING NO: PC-5-7726						