


120 VOLT - 1Ø - 60 Hz - 20 AMP SERVICE

NOTE: RECIRCULATION PUMP, AIR PUMP AND CONTROL PANEL MUST BE PROPERLY GROUNDED.

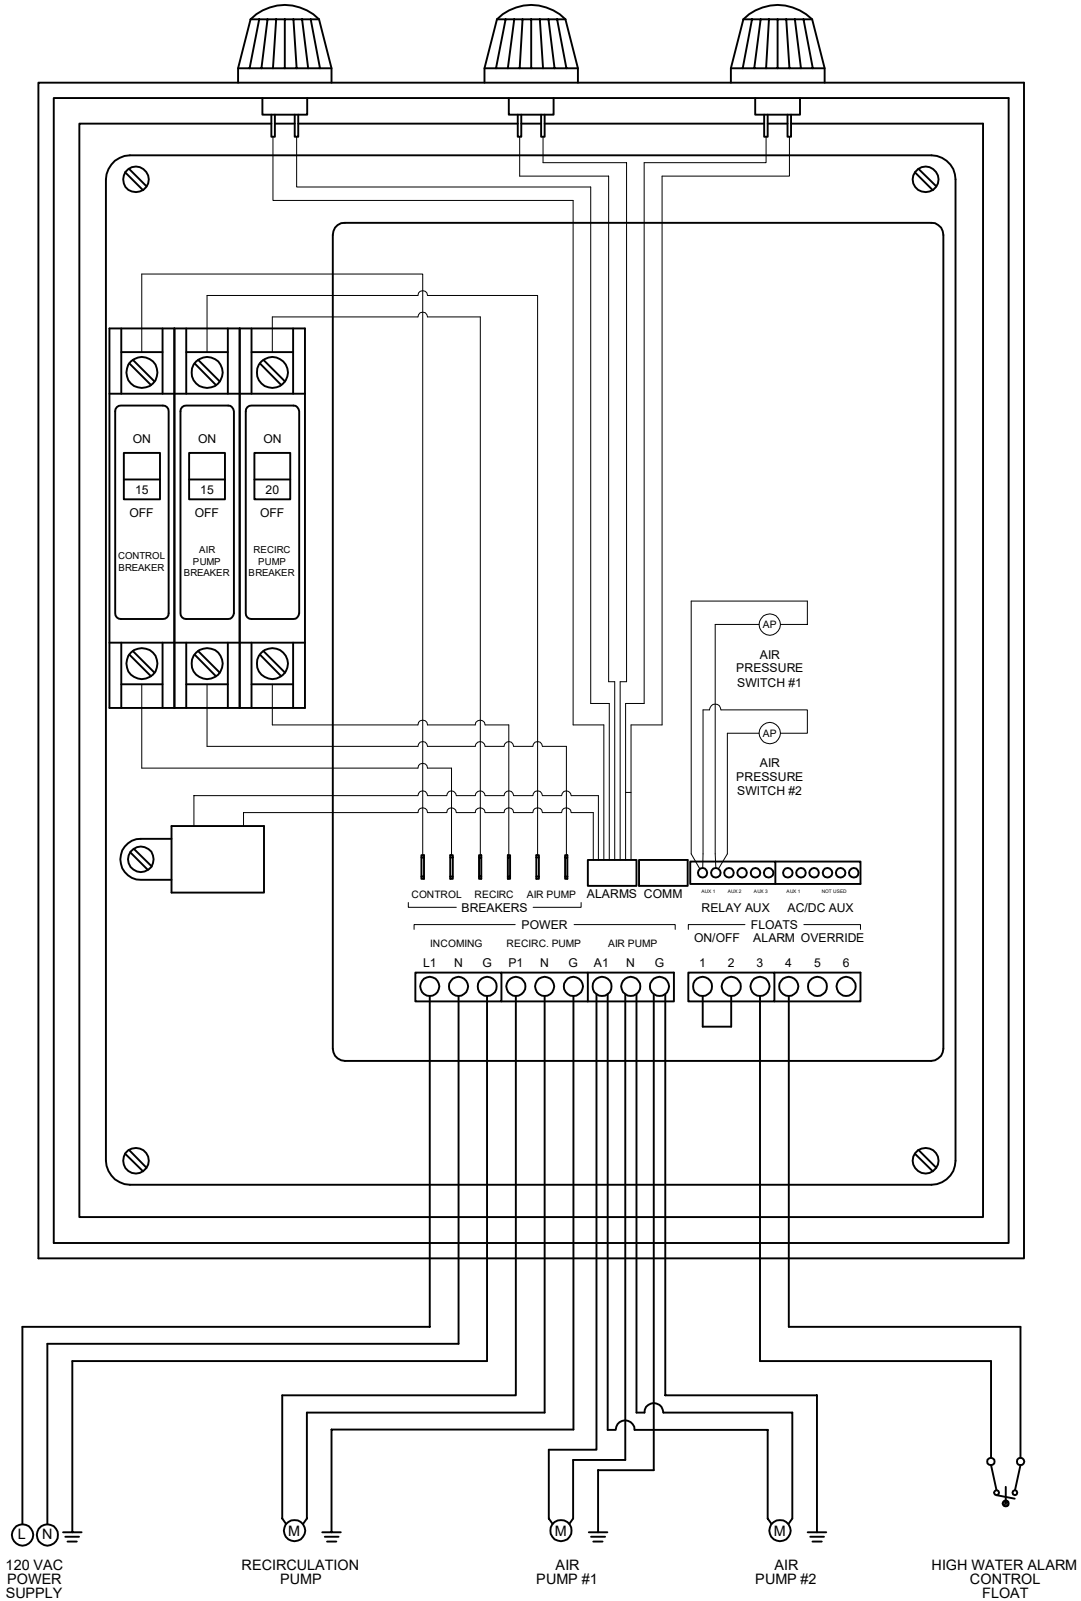

GENERAL NOTES:

- ① A DEDICATED 20 AMP CIRCUIT BREAKER AT MAIN SERVICE PANEL SHOULD NOT BE ENERGIZED UNTIL THE AIR PUMPS ARE INSTALLED AND READY TO BE PLACED INTO OPERATION.
- ② INSURE THE AIR PUMPS ARE OPERATING WHEN THE FACILITY IS OCCUPIED.
- ③ THE LOCAL, LICENSED NORWECO DISTRIBUTOR WILL PLACE THE AIR PUMPS INTO SERVICE.

| | | | | | | | | | | | | | | | | | | | |
|--|--|-----------------------|----------|--|---|----------|----------|--------------|------|-------|------|--------------|------|-----|-----|------------|-----|-----------|--|
| PART NUMBER: | | | | | | | | | | | | | | | | | | | |
| U.S. AND FOREIGN PATENTS PENDING © MMXXIII | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td colspan="2" style="text-align: center;"><i>norweco</i></td> </tr> <tr> <td style="width: 50%; text-align: center;"> SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 1000 - 1500 GPD SYSTEMS </td> <td style="width: 50%;"> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>DESIGNER</td> <td>REVISION</td> </tr> <tr> <td>APPROVED BY</td> <td>DATE</td> </tr> <tr> <td>SCALE</td> <td>DATE</td> </tr> <tr> <td>DESIGNED NO.</td> <td>DATE</td> </tr> </table> </td> </tr> <tr> <td style="text-align: center;">NPD</td> <td style="text-align: center;">JMM</td> </tr> <tr> <td style="text-align: center;">03-01-2023</td> <td style="text-align: center;">NTS</td> </tr> <tr> <td style="text-align: center;">PC-5-7727</td> <td></td> </tr> </table> | <i>norweco</i> | | SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 1000 - 1500 GPD SYSTEMS | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>DESIGNER</td> <td>REVISION</td> </tr> <tr> <td>APPROVED BY</td> <td>DATE</td> </tr> <tr> <td>SCALE</td> <td>DATE</td> </tr> <tr> <td>DESIGNED NO.</td> <td>DATE</td> </tr> </table> | DESIGNER | REVISION | APPROVED BY | DATE | SCALE | DATE | DESIGNED NO. | DATE | NPD | JMM | 03-01-2023 | NTS | PC-5-7727 | |
| <i>norweco</i> | | | | | | | | | | | | | | | | | | | |
| SERVICE PRO WASP MODEL 11A ADVANCED HYDRO-KINETIC WIRING DIAGRAM 1000 - 1500 GPD SYSTEMS | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>DESIGNER</td> <td>REVISION</td> </tr> <tr> <td>APPROVED BY</td> <td>DATE</td> </tr> <tr> <td>SCALE</td> <td>DATE</td> </tr> <tr> <td>DESIGNED NO.</td> <td>DATE</td> </tr> </table> | DESIGNER | REVISION | APPROVED BY | DATE | SCALE | DATE | DESIGNED NO. | DATE | | | | | | | | | | |
| DESIGNER | REVISION | | | | | | | | | | | | | | | | | | |
| APPROVED BY | DATE | | | | | | | | | | | | | | | | | | |
| SCALE | DATE | | | | | | | | | | | | | | | | | | |
| DESIGNED NO. | DATE | | | | | | | | | | | | | | | | | | |
| NPD | JMM | | | | | | | | | | | | | | | | | | |
| 03-01-2023 | NTS | | | | | | | | | | | | | | | | | | |
| PC-5-7727 | | | | | | | | | | | | | | | | | | | |