


120 VOLT - 1Ø - 60 Hz - 20 AMP SERVICE

NOTE: PUMP AND INTEGRATED SYSTEM CONTROL PANEL MUST BE PROPERLY GROUNDED.

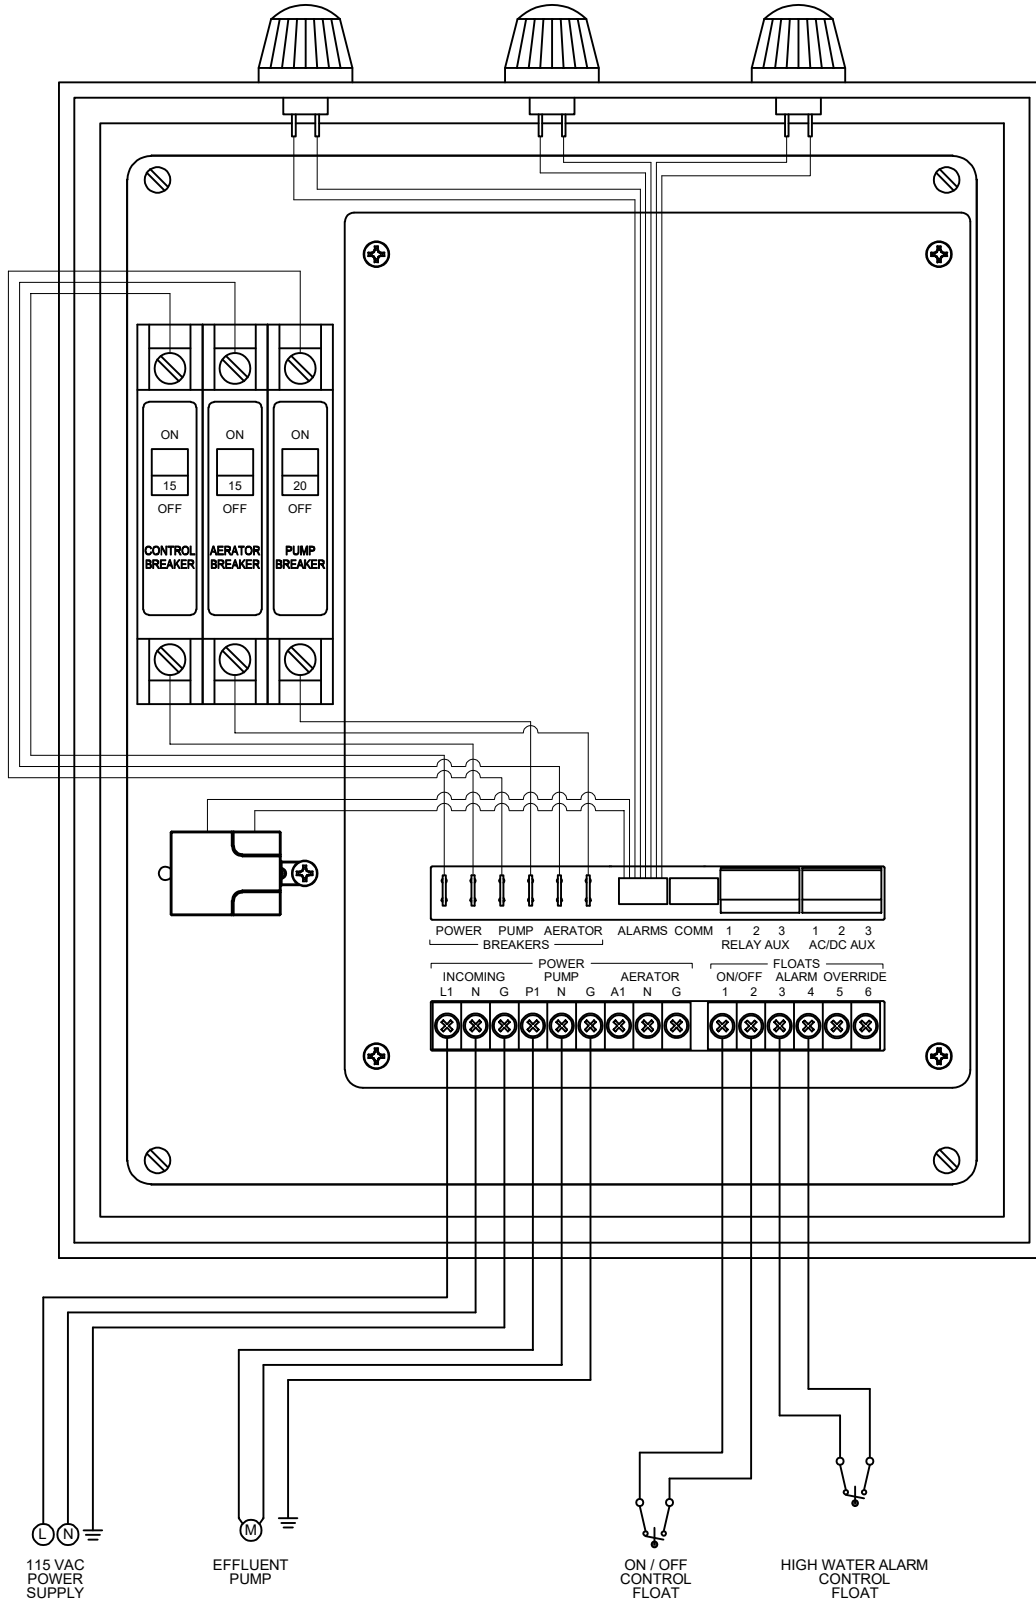

GENERAL NOTES:

- ① A DEDICATED 20 AMP CIRCUIT BREAKER AT MAIN SERVICE PANEL SHOULD NOT BE ENERGIZED UNTIL THE PUMP IS INSTALLED AND READY TO BE PLACED INTO OPERATION.

PART NUMBER:	
U.S. AND FOREIGN PATENTS PENDING © MMXV	<div style="text-align: center;">norweco</div> SERVICE PRO WASP SERIES WIRING DIAGRAM FOR SIMPLEX PUMP STATION <small>THIS DRAWING IS THE PROPERTY OF NORWECO. IT IS TO BE USED FOR THE EQUIPMENT CONVEYED AND NOT BE LOANED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF NORWECO.</small>
DRAWN BY: JMM	REVISION DATE: _____
APPROVED BY: JMM	DATE: 11-13-2024
SCALE: NTS	DRAWING NO: PC-5-7739